


FROM PLATFORM TO THE CENTER  
OF THE METERBASE BETWEEN  
5 AND 6 FEET. CENTER OF THE  
METERBASE TO BE A MINIMUM  
OF 8 FEET FROM FINISHED GROUND.

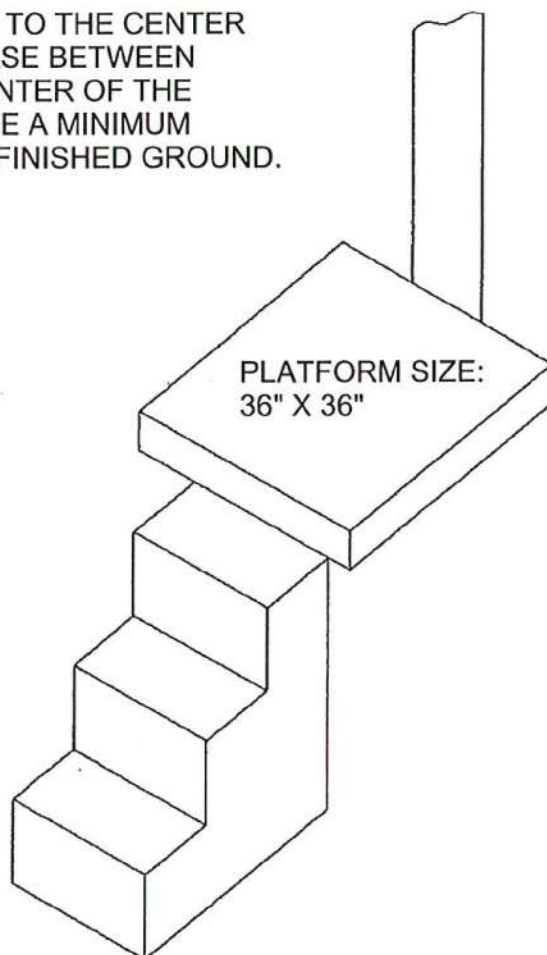

2' INCH TREATED WOOD, STEEL, OR CONCRETE MINIMUM

ALL METERS SUBJECT TO FLOODING  
PICKWICK ELECTRIC COOPERATIVE

PEC 5-18-23